
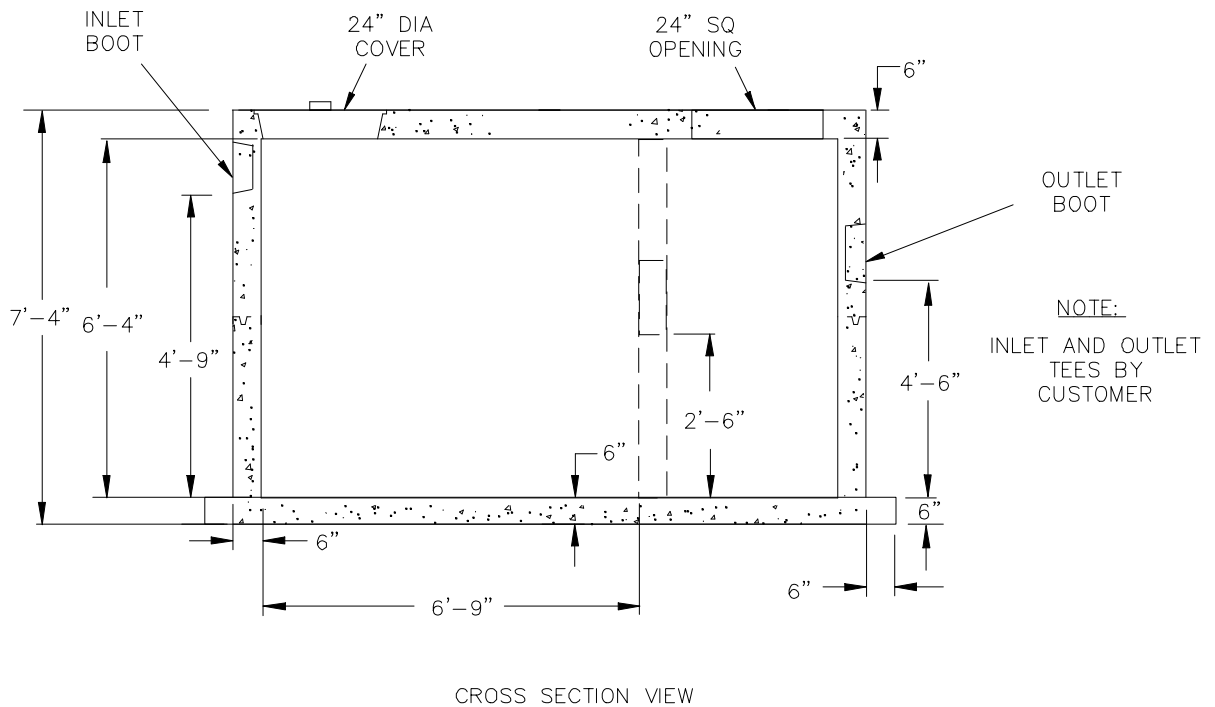


WATER QUALITY TANK

2,000 GALLON (H-20)

WITH EXTENDED BASE

2 Compartment

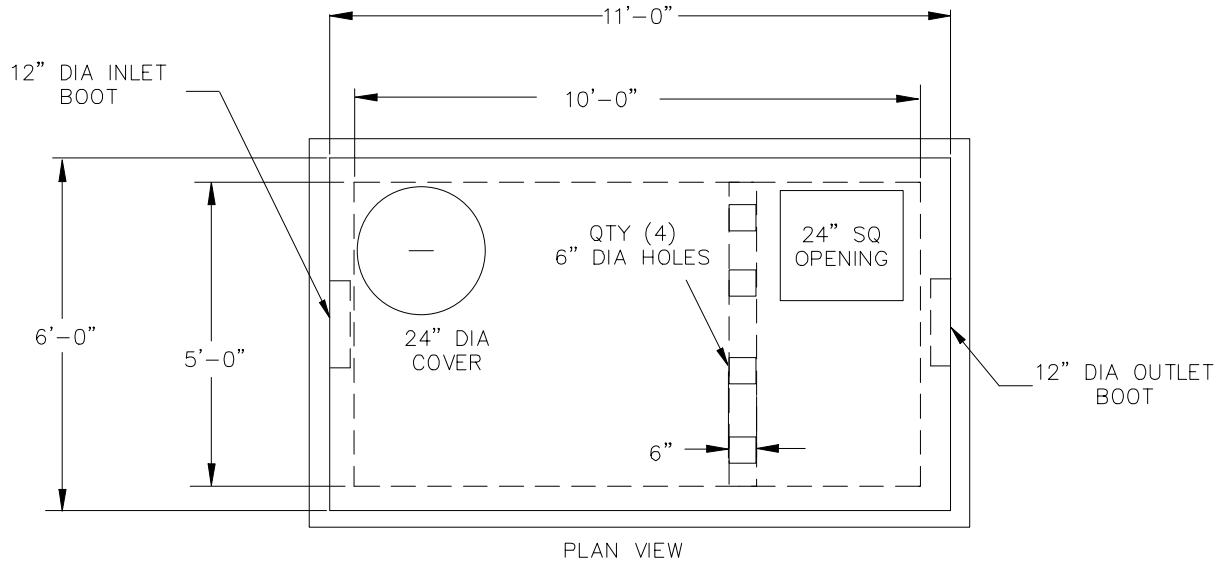

SPECIFICATIONS

- Concrete Minimum Strength: 5,000 P.S.I @ 28 days
- Steel Reinforcement: AS-615-68, Grade 60
- Design Loading: AASHTO - H-20 Meets ASTM Spec. C1227
- Weight: 21,230 lbs.