



# SEPTIC TANK/PUMP CHAMBER - 2,500 GALLON (H-20)

## 2-Compartment

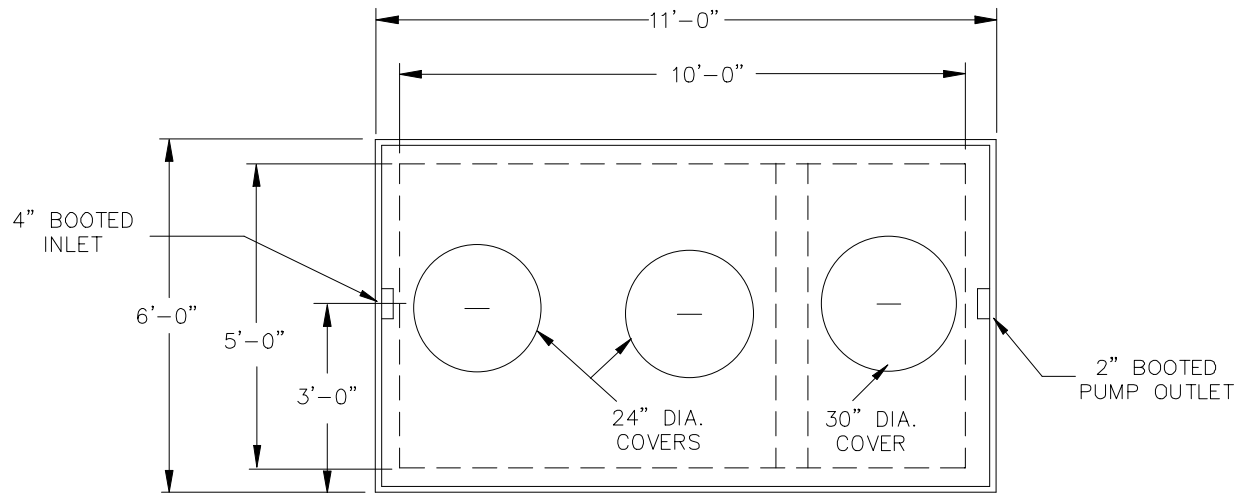

PLAN VIEW

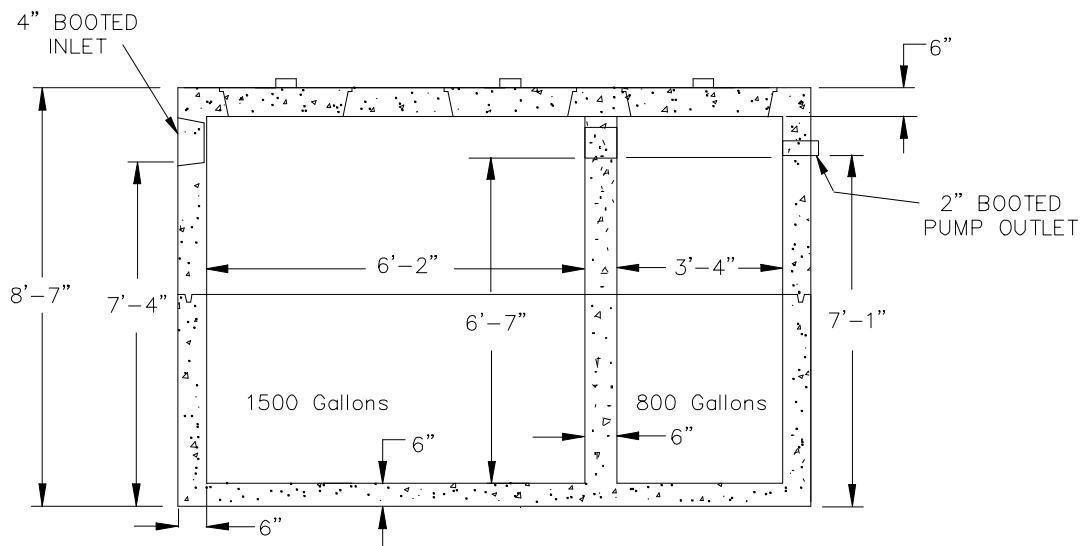

CROSS SECTION VIEW

## SPECIFICATIONS

- Concrete Minimum Strength: 5,000 P.S.I @ 28 days
- Steel Reinforcement: AS-615-68, Grade 60
- Design Loading: AASHTO - H-20 Meets ASTM Spec. C1227
- Weight: 26,420 lbs.
- Tar Coated - CS55 and Water Tight Booted Pipe Connections